Form 4501

Notification: 10301142468

CENTRAL MAINE POWER COMPANY

Work Order: 801000667701

APPLICATION FOR POLE LOCATION OR UNDERGROUND LOCATION

In the City/Town of: Lisbon, Maine

To the:

- ☐ City
- ☒ Town
- ☐ County of: Androscoggin, Maine

☒ Central Maine Power hereby applies for permission to:

☒ Construct and maintain poles together with attached facilities and appurtenances upon, along or across certain streets and highways in said City/Town as described below.

☐ Construct and maintain buried cables, conduits, manholes and handholes, together with wire and cables, transformers, cutouts, and other equipment therein, under, along, and across certain streets and highways in said City/Town as described below.

☒ Central Maine Power Company and Consolidated Communications of Northern New England jointly apply for permission to construct and maintain poles together with attached facilities and appurtenances upon, along or across certain streets and highways in said City/Town as described below.

1. Starting Point: 44.039574, -70.034791
2. Road (State & CMP): Bowdoinham Road (3rd Class Road)
3. Direction: NORTH WEST
4. Distance: 900 feet
5. Number of Poles: 5

☒ Overhead wires shall have a minimum clearance of 18 feet over the public highway and be constructed to conform with the requirements of the National Electric Safety Code.

☐ Buried cable facilities shall be placed at a minimum depth of 36 inches under pavement and 30 inches elsewhere and be constructed to conform with the requirements of the National Electric Safety Code.

Any person, firm, or corporation to be adversely affected by this proposed location shall file a written objection with the State Department of Transportation, City, Town or County stating the cause of said objection within fourteen (14) days after the publication of this notice or ninety (90) days after installation of facilities without publication.

☐ Public Notice of this application has been given by publishing the text of the same

☒ Not Published

In:

On:

CENTRAL MAINE POWER COMPANY

Consolidated Communications of Northern New Eng

By: Edward Adams Date: 2024-12-20

By: Jessica Theriault Date: 12/23/2024

Jessica Theriault - Right of Way

Form 4502

Notification: 10301142468

CENTRAL MAINE POWER COMPANY

Work Order: 801000667701

SKETCH TO ACCOMPANY APPLICATION FOR POLE OR UNDERGROUND LOCATIONS


City / Town: LISBON

Date: 12-12-2024

Street: BOWDOINHAM ROAD (3RD CLASS ROAD)

By: EDWARD ADAMS

Facilities to consist of wood poles and appurtenances with a minimum clearance of wire and cables not less than 21 feet over the public highway, and/or underground facilities to consist of buried cables, conduits, transformers and manholes for operation at 7200 volts to ground single phase. Construction to be suitable for future operation at a voltage not to exceed 22KV to ground single phase. Right-of-way limits indicated are based on the best field information available. at Central Maine Power Poles/ Pads are staked. For further information call: EDWARD ADAMS at Central Maine Power Company tel: (207)-450-3026 . Pole/Pad spans shown are approximate.

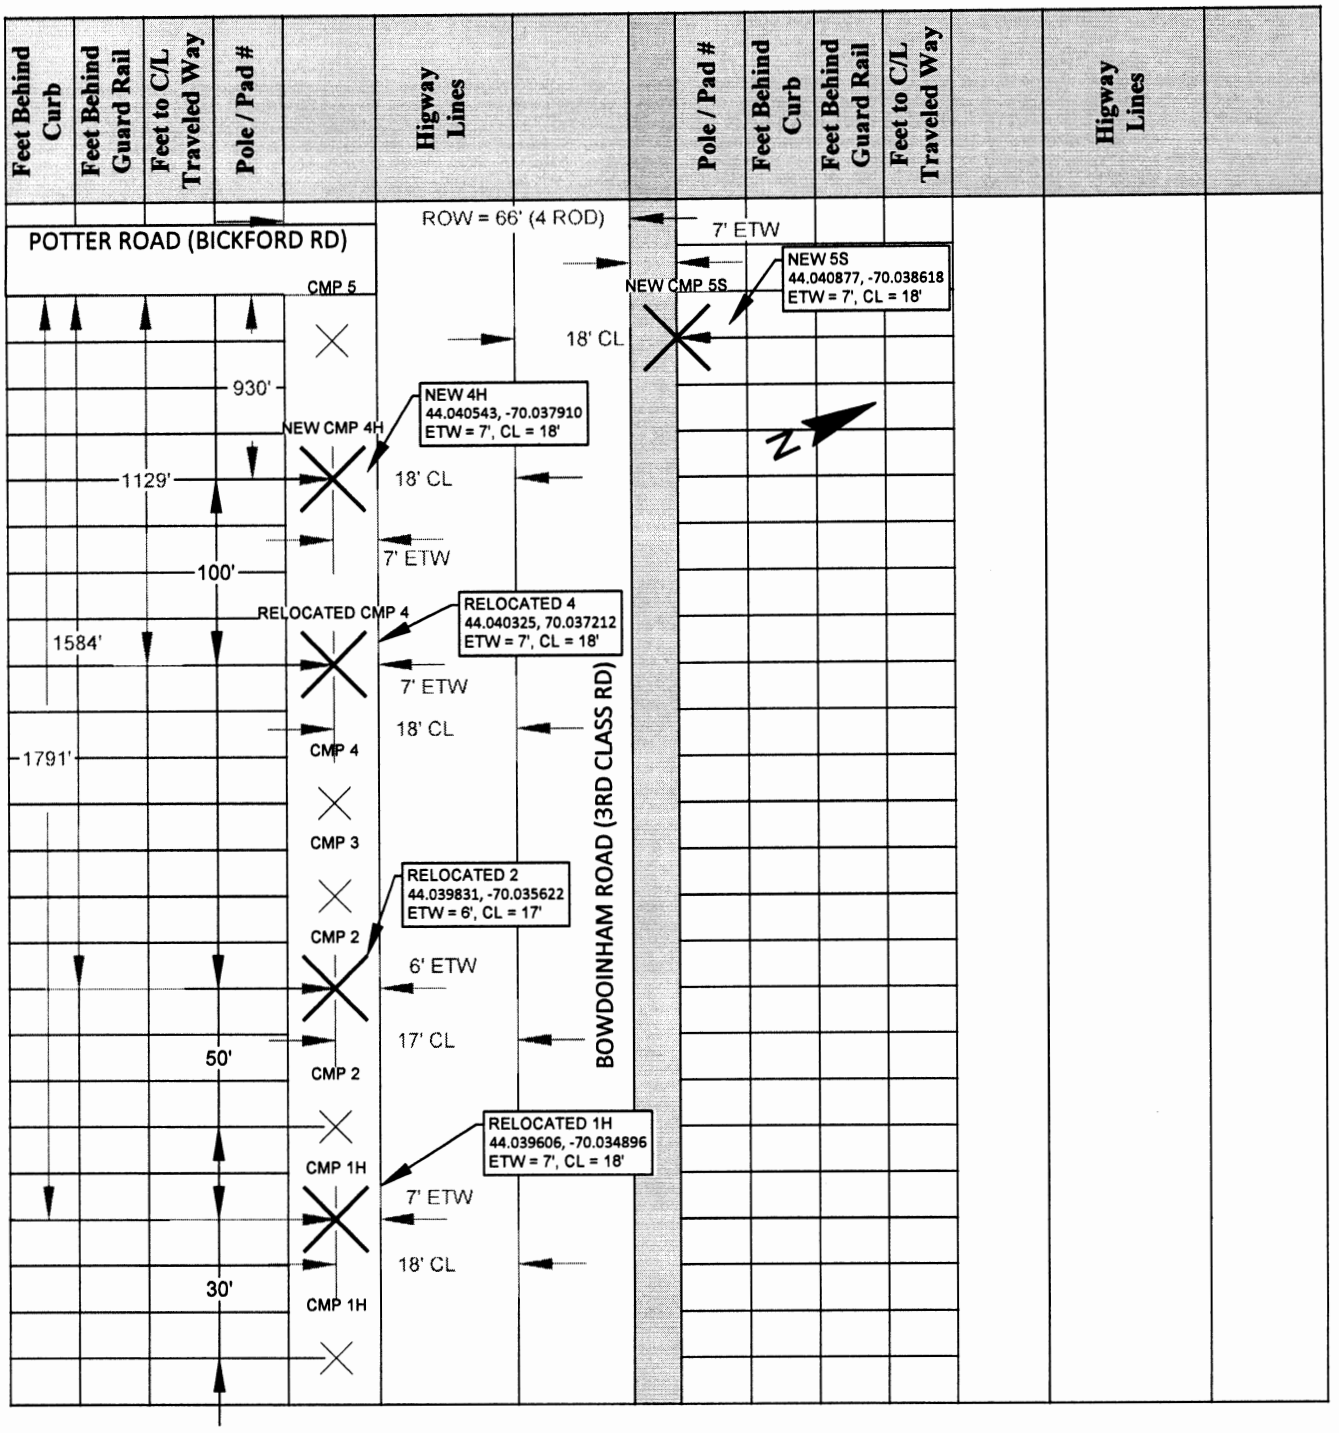

Form 4503

Notification: 10301142468

Work Order: 801000667701

LOCATION PERMIT

Upon the Application of Center Maine Power Company and Consolidated Communications of Northern New En, dated Dec 20, 2024, asking for permission, in accordance with law, to construct and maintain poles, buried cables, conduits, and transformers, together with attached facilities and appurtenances over, under, along or across certain highways and public roads in the location described in said application, permission is hereby given to construct, reconstruct, maintain and relocate in substantially the same location, said facilities and appurtenances in the City / Town of Lisbon, approximately located as follows:

1. Starting Point: 44.039574, -70.034791
2. Road (State & CMP): Bowdoinham Road (3rd Class Road)
3. Direction: NORTH WEST
4. Distance: 900 feet
5. Number of Poles: 5

Facilities shall consist of wood poles and appurtenances with a minimum of wire and cable not less than 18 feet over the public highway and/or buried cables or conduit and appurtenances placed a minimum depth of 36 inches under pavement and 30 inches elsewhere, all in a manner conforming to the National Electric Safety Code.

By:_____

By:_____

By:_____

By:_____

By:_____


Municipal Officers

Office of the _____

Received and Recorded in Book_____, Page_____

Attest:_____

Clerk

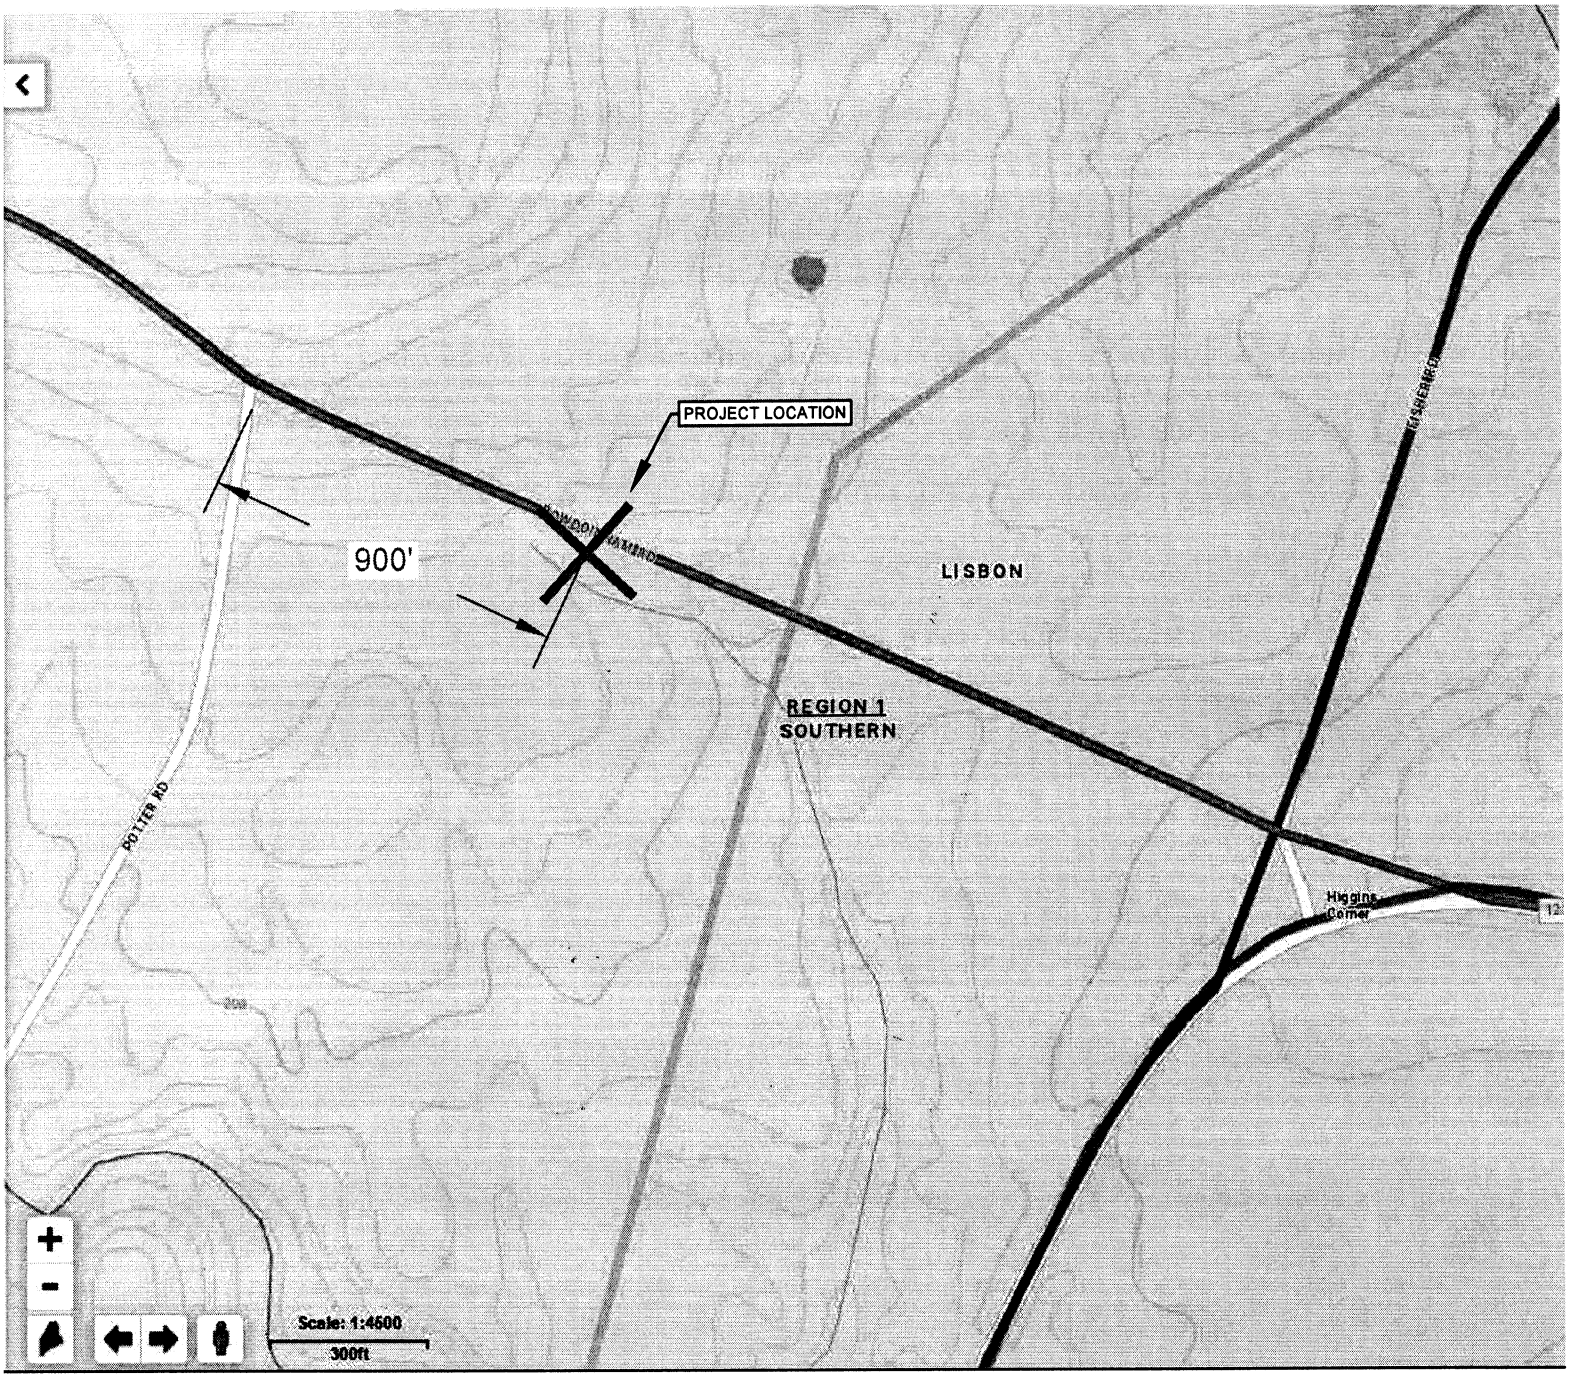

MDOT MAP VIEWER SNIP

LISBON POLE PERMIT INSPECTION REPORT

PERMIT REQUESTED BY: CMP (Edward Adams)

LOCATION: Bowdoinham Rd

CODE ENFORCEMENT DEPARTMENT

I, MARK STANBERY, have reviewed the application and find the pole is located in front of property owned by: MARJORIE ARNDT

and the physical address of the property is: BOWDOINHAM ROAD MAP 03 LOT 019

Additional Comments: _____

Approved Date: 1/7/25 Signed by: Mark C Stanbery

****

Deny permission for the following reason: _____

_____

Date Denied: _____ Signed by: _____

PLEASE FORWARD TO PUBLIC WORKS DEPARTMENT

PUBLIC WORKS DEPARTMENT

I, Pat Maloy, have visually inspected this location and find no reason to prohibit placing pole(s) where requested.

Additional Comments: I found that Bowdoinham Rd is a 4 Rod Road

Approved Date: 12/20/24 Signed by: Pat Maloy

****

Deny permission for the following reason: _____

_____

Date Denied: _____ Signed by: _____

PLEASE RETURN TO THE TOWN CLERK